

This document provides instructions for standard rack mount installation of the device.

This accessory kit includes hardware for mounting the device in a 19" Telco rack from the front of the device.

This accessory kit supports the following devices:

- S1500-24P/48P Mobility Access Switch
- S2500 Mobility Access Switch.
- 7205 Controller
- 7024 Controller

## Package Contents

- Two rack mount brackets
- Eight M4 x 8 mm Phillips Flat Head screws
- Four M6 x 15 mm Phillips Pan Head screws
- Installation Guide (this document, printed)

## Required Tools and Equipment

- Two Rack mount brackets
- Eight M4 x 8 mm Phillips Flat Head screws
- Four M6 x 15 mm Phillips Pan Head screws
- Suitable screwdrivers for both screw types (not included in this kit)



NOTE

---

Some racks require screws that differ from those included with the device. Confirm that you have the correct screws before installing this device.

---



CAUTION

---

Each device should have its own mounting equipment. Do not place other networking equipment directly on top of a mounted device. Failure to do so can result in damage to the device.

---

## Installation Steps



NOTE

---


The figures in this document illustrate the installation procedure for the 7205 controller. You can refer to these figures for the installation of the other supported devices.

---

To install the device into a two-point 19" (48.26 cm) rack system:


1. Place the mounting brackets over the mounting holes near the front on either sides of the device (see [Figure 1](#)).

**Figure 1** Attaching the Mounting Brackets (7205)

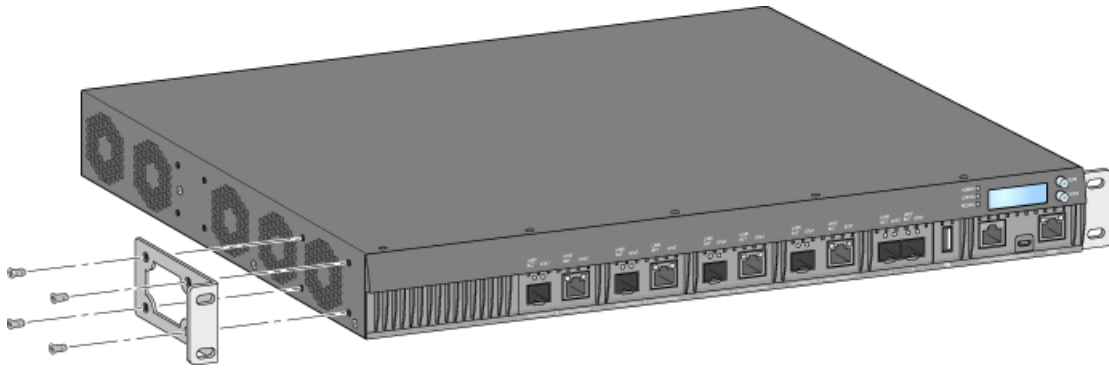

2. Secure the brackets to the device using the eight M4 x 8 mm Phillips flat Hhad screws (four per bracket) and a suitable screwdriver.
3. Mount the device in the rack using the four M6 x 15 mm Phillips Pan Head screws (two per bracket) and a suitable screwdriver (see [Figure 2](#)).

**Figure 2** Rack Mounting (7205)

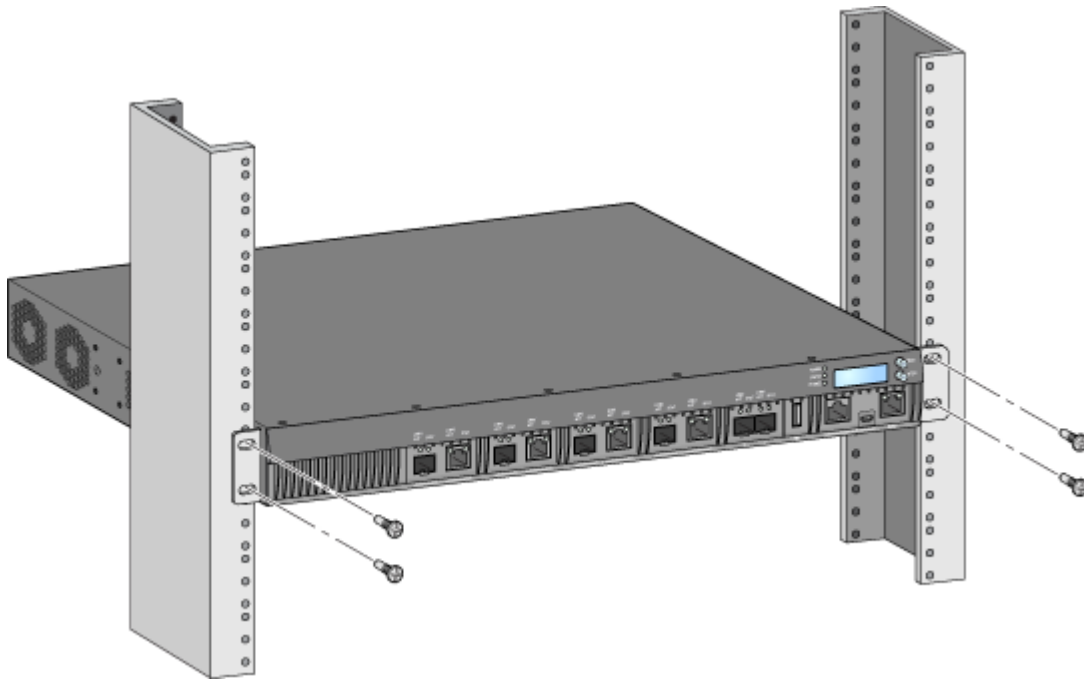

4. Leave a minimum of four inches (10 cm) of space on the left and right side of the unit for proper air flow and ventilation.
5. Leave additional space in front and back of the unit to access power cords, network cables, and LED status indicators.

# Contacting Support

**Table 1** *Contact Information*

Main Site	<a href="http://arubanetworks.com">arubanetworks.com</a>
Support Site	<a href="http://support.arubanetworks.com">support.arubanetworks.com</a>
Airheads Social Forums and Knowledge Base	<a href="http://community.arubanetworks.com">community.arubanetworks.com</a>
North American Telephone	1-800-943-4526 (Toll Free) 1-408-754-1200
International Telephones	<a href="http://www.arubanetworks.com/support-services/contact-support/">http://www.arubanetworks.com/support-services/contact-support/</a>
Software Licensing Site	<a href="http://licensing.arubanetworks.com">licensing.arubanetworks.com</a>
End of Support information	<a href="http://www.arubanetworks.com/support-services/end-of-life-products/end-of-life-policy/">http://www.arubanetworks.com/support-services/end-of-life-products/end-of-life-policy/</a>
Security Incident Response Team (SIRT)	<a href="http://www.arubanetworks.com/support-services/security-bulletins/">http://www.arubanetworks.com/support-services/security-bulletins/</a>
<b>Support Email Addresses</b>	
Americas, APAC, and EMEA	<a href="mailto:support@arubanetworks.com">support@arubanetworks.com</a>
Security Incident Response Team (SIRT)	<a href="mailto:sirt@arubanetworks.com">sirt@arubanetworks.com</a>

© 2015 Aruba Networks, Inc. All rights reserved.



**0511788-02**



[www.arubanetworks.com](http://www.arubanetworks.com)

1344 Crossman Avenue  
Sunnyvale, California 94089

Phone: 408.227.4500  
Fax 408.227.4550